

Form DST-02: Quarterly Review

WATER YEAR: 1 July 2021 to 30 June 2022

REVIEW DATE: 4/10/21

FORECAST AND ACTUAL WATER DEMAND:

	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter
Forecast, ML	1044	1446	1763	1228
Actual, ML	1077			

REVIEW: Storage tracking (see graph) Below predicted
 POAMA forecast (circle) DRY NEUTRAL WET

BOM three-month rainfall outlook (chance of exceeding)

3-month rainfall	10mm	25mm	50mm	100mm	150mm	200mm	250mm	300mm	400mm
Chance of exceeding	100%	100%	99%	94%	69%	40%	17%	8%	0%

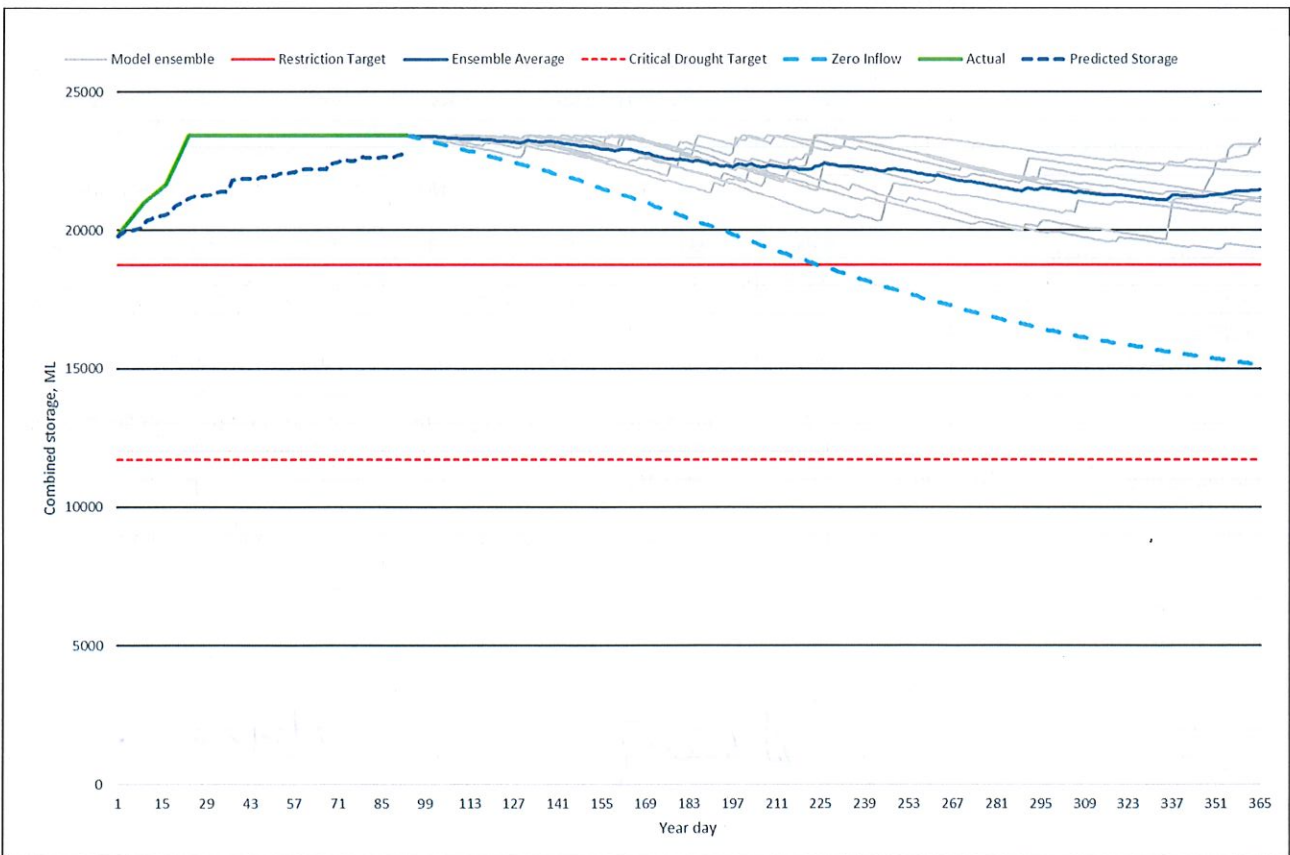


Figure 1: Modelled and actual storage behaviour

ANY OPERATIONAL CONSIDERATIONS?

Macquarie pumps out for maintenance.

ANY ACTIONS FROM ANNUAL REPORT?

Nil

DO THE RULES NEED TO BE MODIFIED (circle)? YES **NO**
 (if yes, please document below)

Macquarie River margin of error to apply to flow trigger: 0%

Is water assignment from Macquarie River still required? YES **NO**
 If no, date DPI Water advised _____

REVISED OPERATING RULES BASED ON QUARTERLY REVIEW:

Source	Required?		Operating Rules							
	Yes	No	SPD Trigger	Annual Transfer ML/year	Weekday Pump Hours		Weekend Pump Hours			
Showground Bores	✓		SPD Trigger	Annual Transfer ML/year	Weekday Pump Hours		Weekend Pump Hours			
			100%	280	12		12			
Clifton Grove Bores	NA	NA	SPD Trigger	Annual Transfer ML/year	Weekday Pump Hours		Weekend Pump Hours			
			100%	182	Not available		Not available			
Stormwater Harvesting (no. of operating pumps at each pump station shown)	✓		SPD Trigger	PS1	PS2	PS3	PS4	PS5	PS6	
			100%	2	2	2	2	2	2	
Macquarie River	NA	NA	SPD Trigger	River Flow Trigger, ML/day	No. of pumps		Weekday Pump Hours	Weekend Pump Hours		
			90%	108	Not available		Not available	Not available		

APPROVAL:

Prepared by:

Water and Sewerage Strategic Manager: Wayne Beatty	Signature: <i>W. Beatty</i>	Date: 2/2/22
---	--------------------------------	-----------------

Reviewed and authorised by:

Director Technical Services: Ian Greenham	Signature: <i>I. Greenham</i>	Date: 4/10/2021
--	----------------------------------	--------------------